

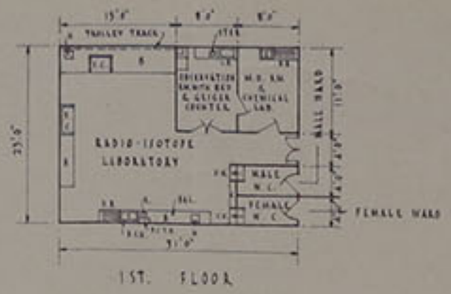

RADIO-ISOTOPE SECTION

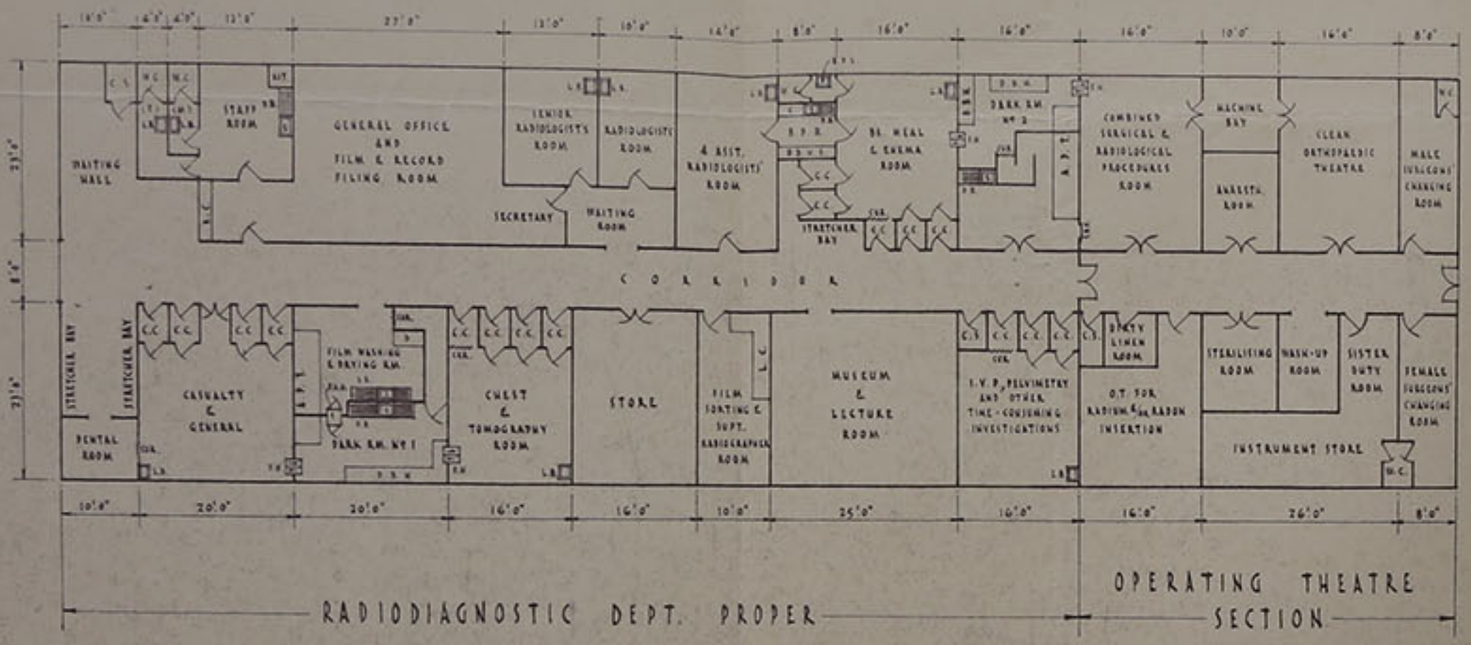

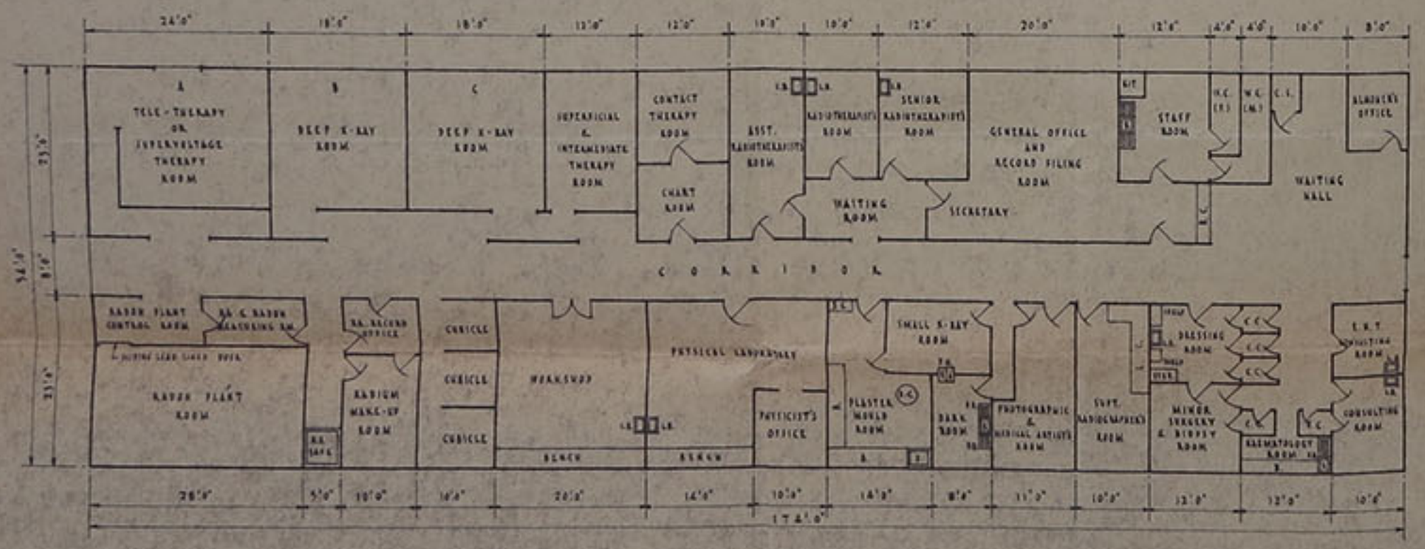

RADIOTHERAPEUTIC SECTION

Appendix 3A

NOTES :—

A.P.T.	AUTOMATIC PROCESSING TANK
B.	BENCH
BA.	BARIUM
BAL.	BALANCE
B.B.W.S.	BENCH FOR BOILING WATER & STERILISER
B.P.R.	BARIUM PREPARATION ROOM
B.P.S.	BED PAN STERILISER
C.	CUPBOARD
C.C.	CHANGING CUBICLE
C.S.	COOLIE STORE
D.	DESK
D.B.	DRAINING BOARD
D.B.W.	DRY BENCH & DUPPERS UNDER
D.S.	DRAIN SINK UNDER
F.C.	FUME CUPBOARD
F.D.S.U.	FUNNEL FOR DISPOSAL OF SAFE URINE
F.W.	FILM WATCH
H.	HOIST
KIT.	KITCHENETTE
L.B.	LAVATORY BASIN
L.C.	LINEN CUPBOARD
P.C.T.W.	PIPE CASING TILTED AS NECESSARY
R.	REJECTOR
RA.	RADIUM
R.C.	RECEPTION COUNTER
S.	SINK
S.C.	SHELF CUPBOARD
S.S.V.	SINK & STOP VALVE UNDER REJECTOR
STER.	STERILISER
S.W.W.	SLIDING WINDOW WATCH FOR WET FILM
T.P.W.S.	TANK WITH PIPE LEADING INTO THE HOSPITAL SEWAGE UNDER THE BENCH
U.W.	URINAL WATCH
CUR.	CURTAIN
F.W.W.	FILM WANGERS WATCH

ACTG CHIEF ARCHITECT
ARCHITECTURAL OFFICE
P. W. D. HONG KONG

NEW KOWLOON HOSPITAL

DRAWING NO A P/572
SCALE 1 INCH = 16 FEET
DATE 19TH FEBRUARY, 1954.